

## Addendum No. 1

Date: March 21, 2018

Project: Burgess/Norton/Dakota Halls Water Main at USD  
OSE # RO618-13X  
Vermillion, South Dakota

Engineer: Paul J. Korn, PE  
Sayre Associates, Inc.

Bid Date: Thursday, March 22, 2018 at 4:00 PM

### Scope of this Addendum:

To all bidders and all others to whom drawings and specifications have been issued by Sayre Associates, Inc. Acknowledge receipt of this addendum by listing its number and date in the Bid Form. Failure to do so may subject bidder to disqualification. This Addendum forms a part of the Contract Documents. It modifies them as follows:

### Sheet 5 and Sheet 6 – Sidewalk Removal & Replacement:

The Contractor shall include in the base bid the removal of 64.4 SY of additional concrete sidewalk and placing 580 SF of additional 5" concrete sidewalk adjacent to Burgess Hall as indicated on attached Exhibit A.

### Sheet No. 7 – Erosion Control:

The permanent seed mixture shall be as follows:

Quality Green Turf Mix (or approved equal):

Improved Kentucky Bluegrass (minimum 3 varieties)	155 lbs/acre
Fine-leaf Perennial Ryegrass (minimum 3 varieties)	65 lbs/acre
<u>Creeping Red Fescue</u>	<u>40 lbs/acre</u>
<b>Totals</b>	<b>260 lbs/acre</b>

Fertilizer shall have a minimum guaranteed analysis of 12-24-12 with a minimum of 25% SCU for slow release properties. The application rate shall be 100 lbs/acre. Any other fertilizer analysis and/or application rate must be approved by the Engineer prior to application.


Fiber mulch shall be biodegradable, dyed-wood, cellulose-fiber mulch; nontoxic and free of plant-growth or germination inhibitors; with a maximum moisture content of 15 percent and a pH range of 4.5 to 6.5.

End of Addendum

# EXHIBIT A



SCALE: 1" = 30'

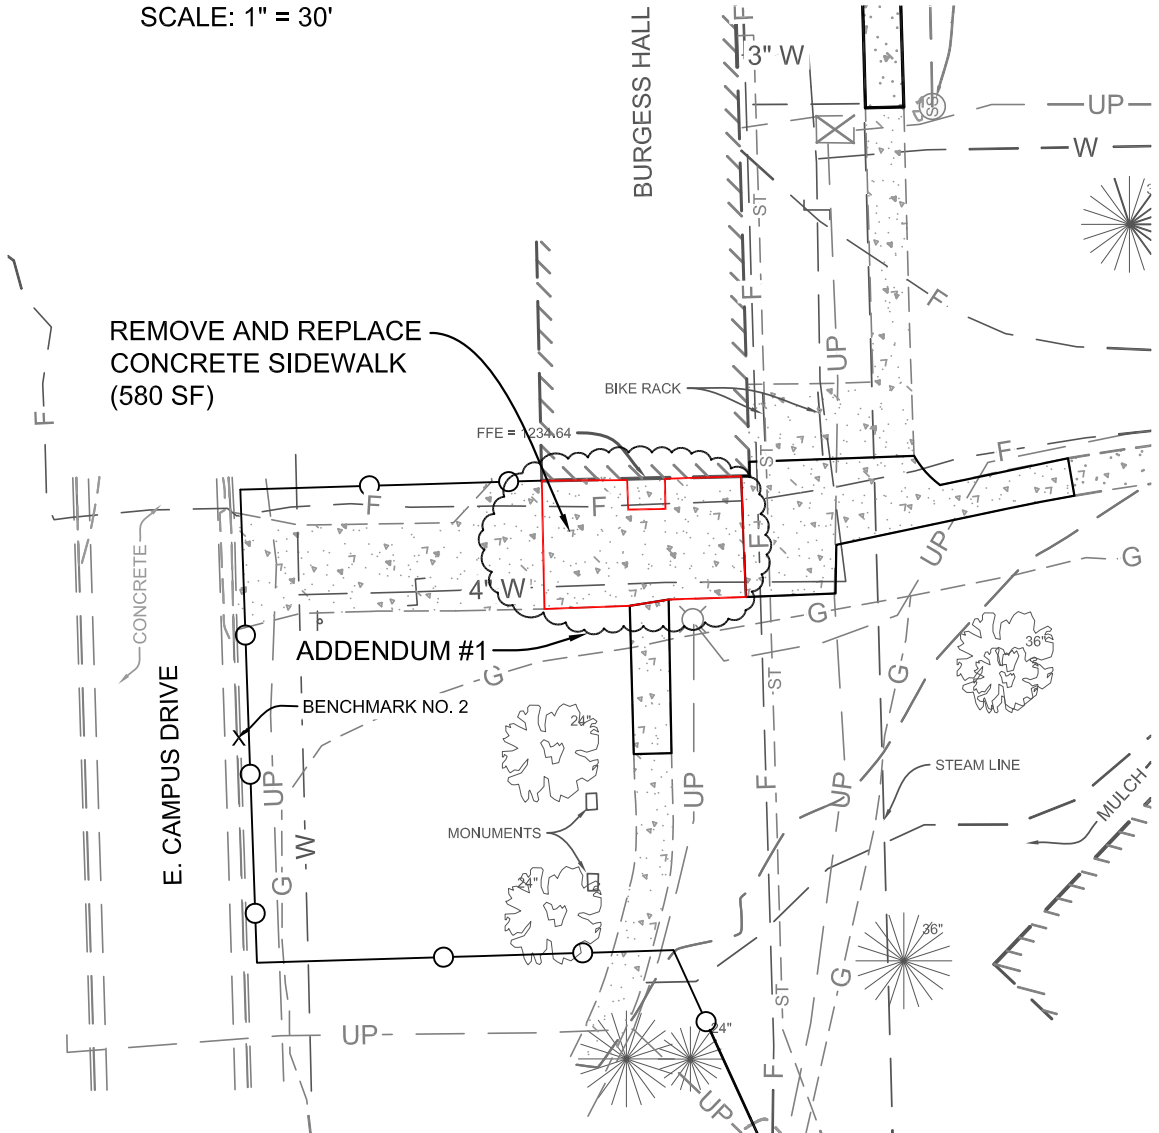

USD WATER MAIN REPLACEMENT	DRAWN BY:	BJB	DATE:	03/21/2018
	CHECKED BY:	PJK	PROJECT NO.:	21406

**Sayre Associates**  
 216 S. Duluth Avenue • Sioux Falls, SD 57104  
 Phone: (605) 332-7211 • Fax: (605) 332-7222  
**Engineers • Surveyors**